



Luminaire Schedule						
Symbol	Qty	Label	Arrangement	Total Lamp Lumens	LLF	Description
	2	KT-FLED60-R1A-UNV-8CSB-VDIM-c	Single	7605.6	0.900	Single Flood 60w

Calculation Summary									
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	Workplane Height	
Room_1_Wall_1	Illuminance	Fc	4.69	50	0	N.A.	N.A.	0 to 50	
Room_1_Wall_2	Illuminance	Fc	2.93	14	0	N.A.	N.A.	0 to 50	
Room_1_Wall_8	Illuminance	Fc	2.67	13	0	N.A.	N.A.	0 to 50	
Room_1_Wall_9	Illuminance	Fc	4.63	49	0	N.A.	N.A.	0 to 50	
Room_1_Wall_Total	Illuminance	Fc	3.96	50	0	N.A.	N.A.	N.A.	



Luminaire Location Summary						
LumNo	Label	X	Y	Mount Height	Orient	Tilt
1	KT-FLED60-R1A-UNV-8CSB-VDIM-c	98.3	57.3	0.25	270	30
2	KT-FLED60-R1A-UNV-8CSB-VDIM-c	43.8	57.3	0.25	270	30



Carroll Uni Kilgour Hall
 KT-FLED60-R1A
 MH- .25' Tilt - 30°

Keystone Technologies Lighting Layout
 2750 Morris Road
 Lansdale, PA 19446
 Phone 1-800-464-2680
 Email: LightingLayouts@keystonetech.com




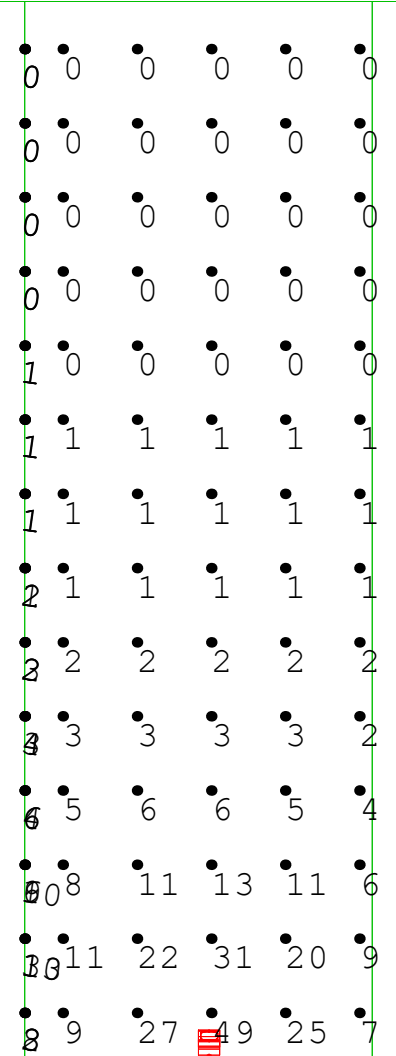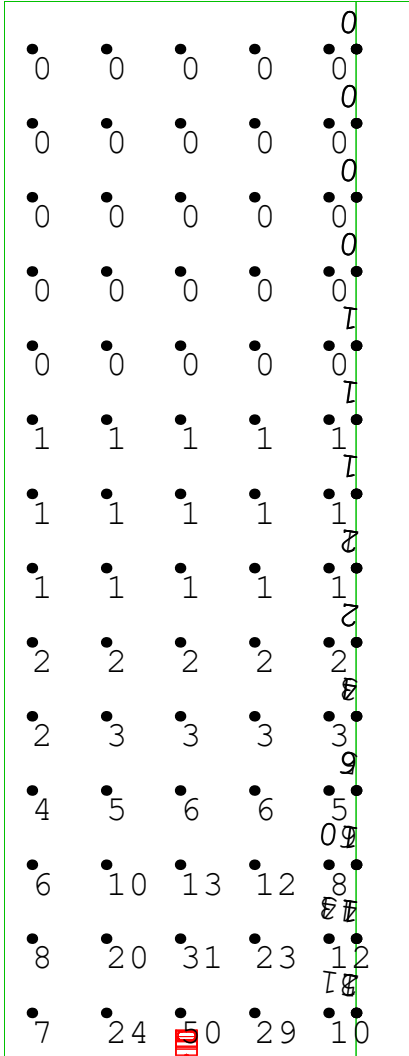

View of point by point

<p>Carroll Uni Kilgour Hall KT-FLED60-R1A MH- .25' Tilt - 30°</p>	<p>Keystone Technologies Lighting Layout 2750 Morris Road Lansdale, PA 19446 Phone 1-800-464-2680 Email: LightingLayouts@keystonetech.com</p>
---	--



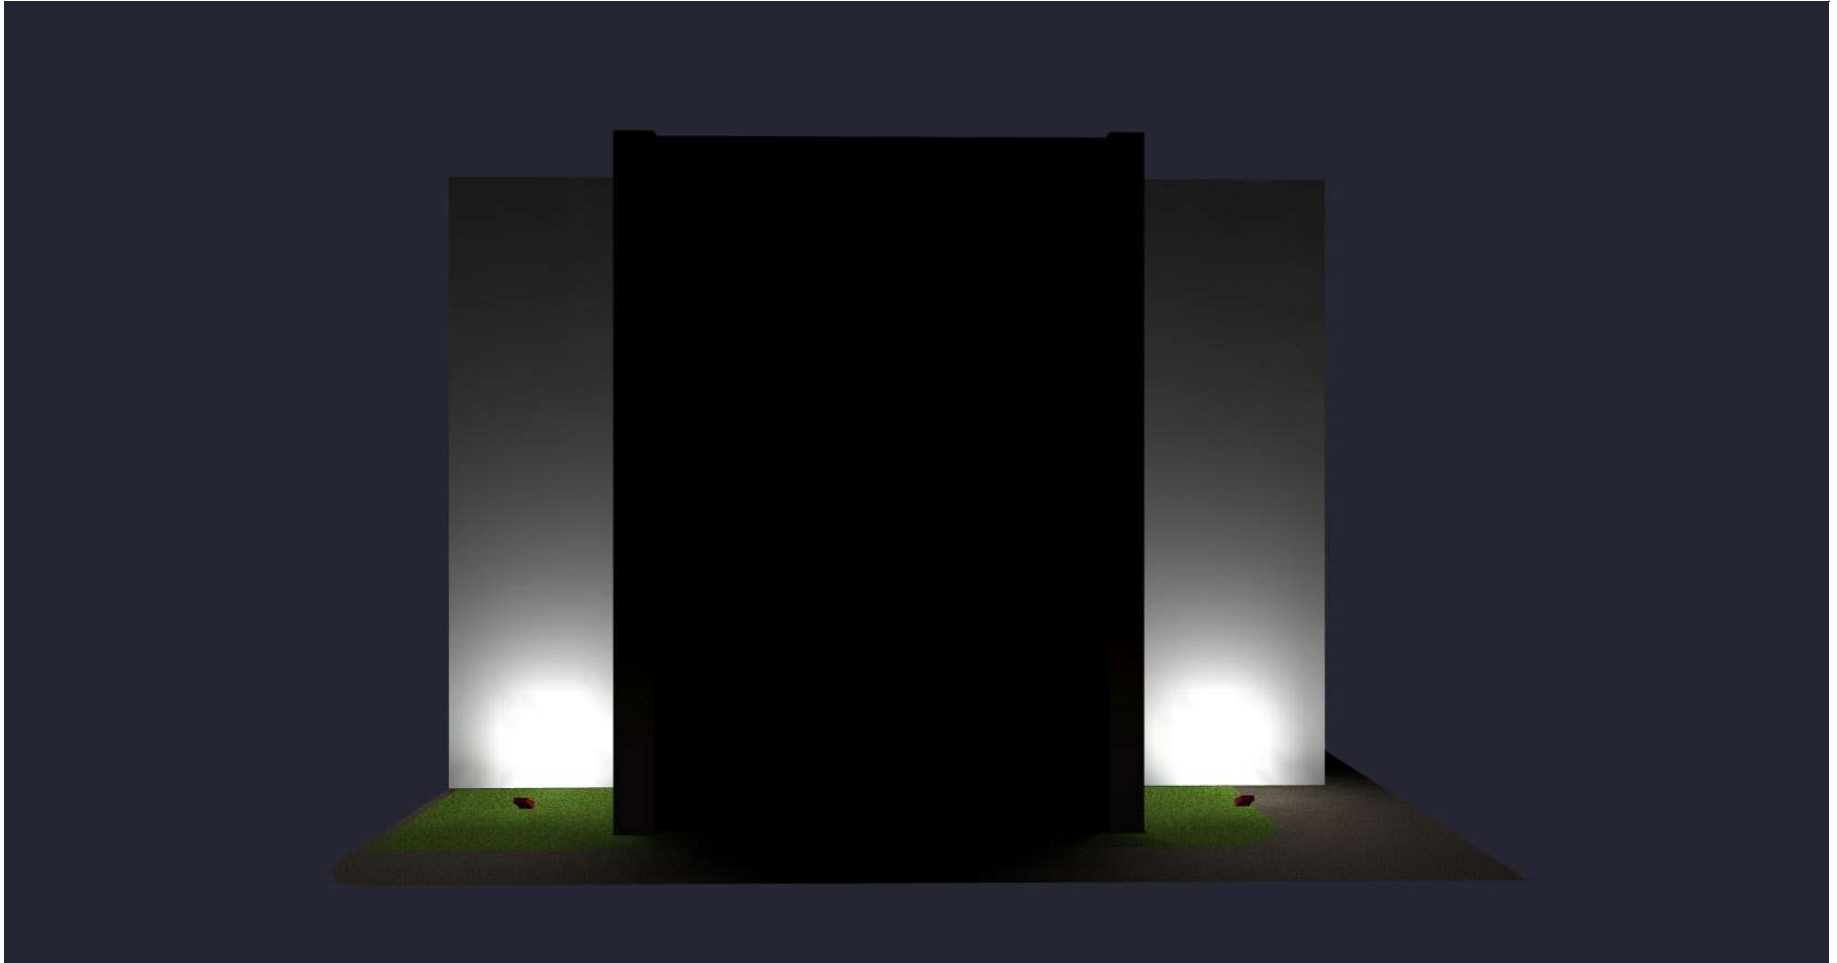


Carroll Uni Kilgour Hall
KT-FLED60-R1A
MH- .25' Tilt - 30°

Keystone Technologies Lighting Layout

2750 Morris Road
Lansdale, PA 19446
Phone 1-800-464-2680
Email: LightingLayouts@keystonetech.com



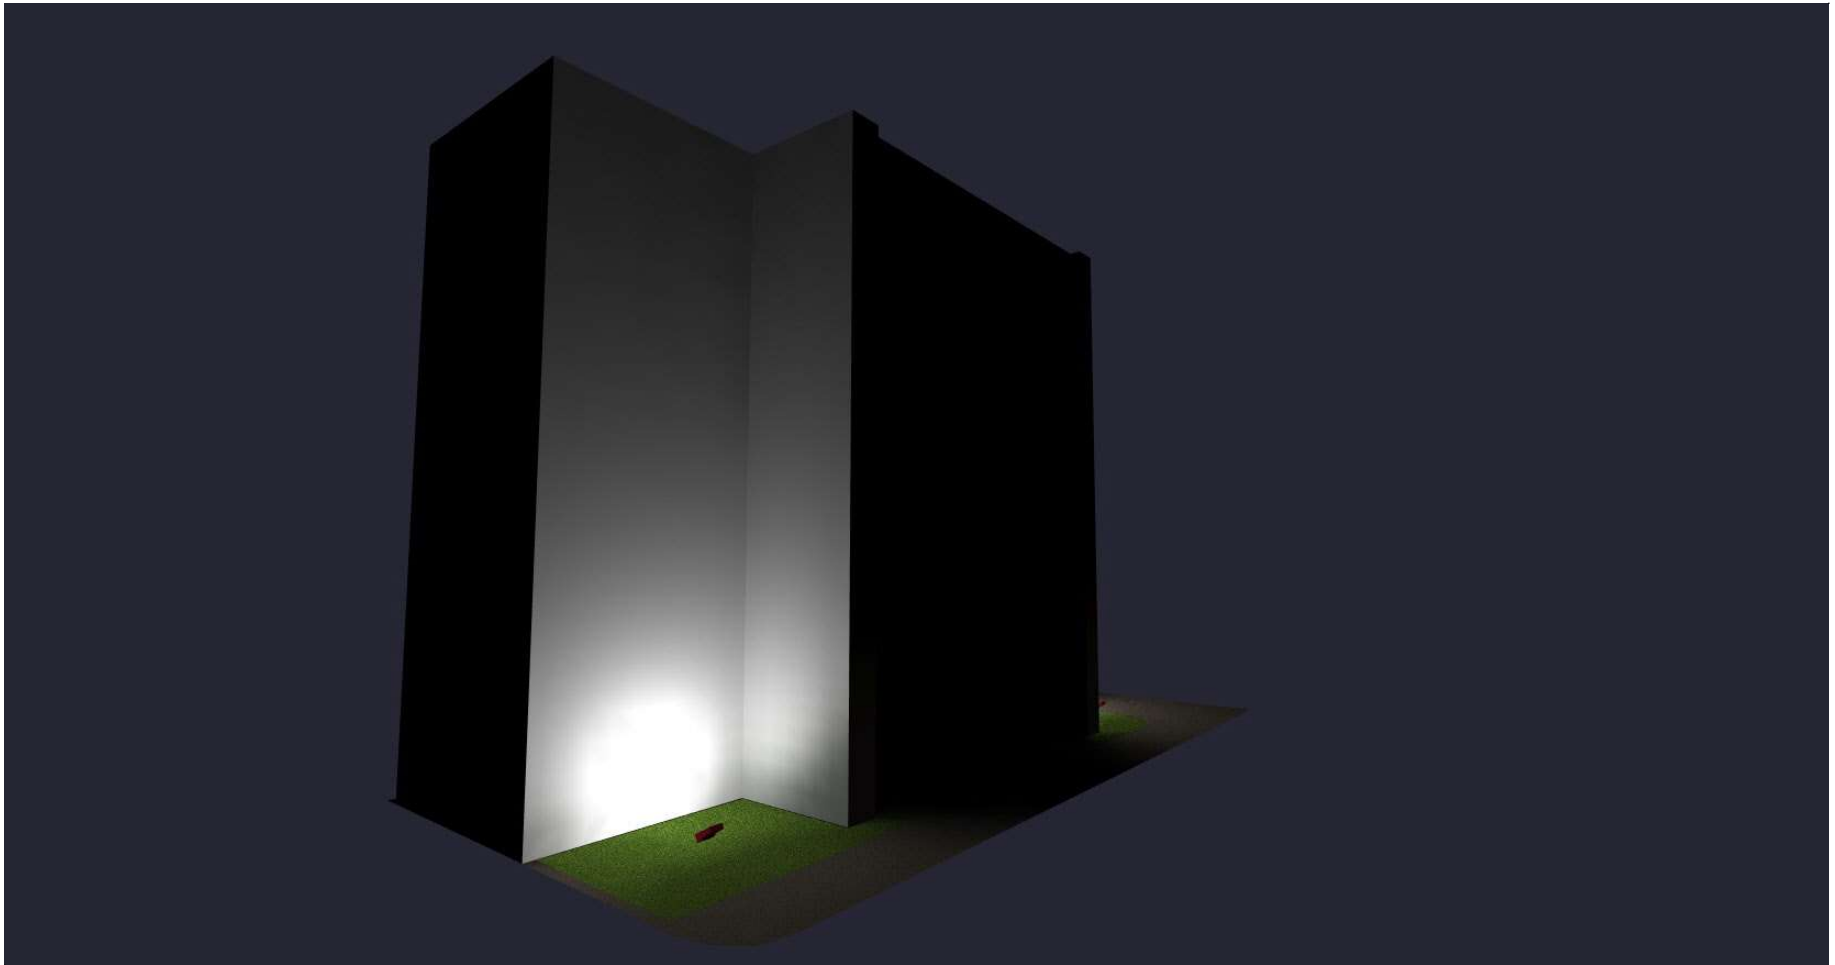


Carroll Uni Kilgour Hall
KT-FLED60-R1A
MH- .25' Tilt - 30°

Keystone Technologies Lighting Layout

2750 Morris Road
Lansdale, PA 19446
Phone 1-800-464-2680
Email: LightingLayouts@keystonetech.com



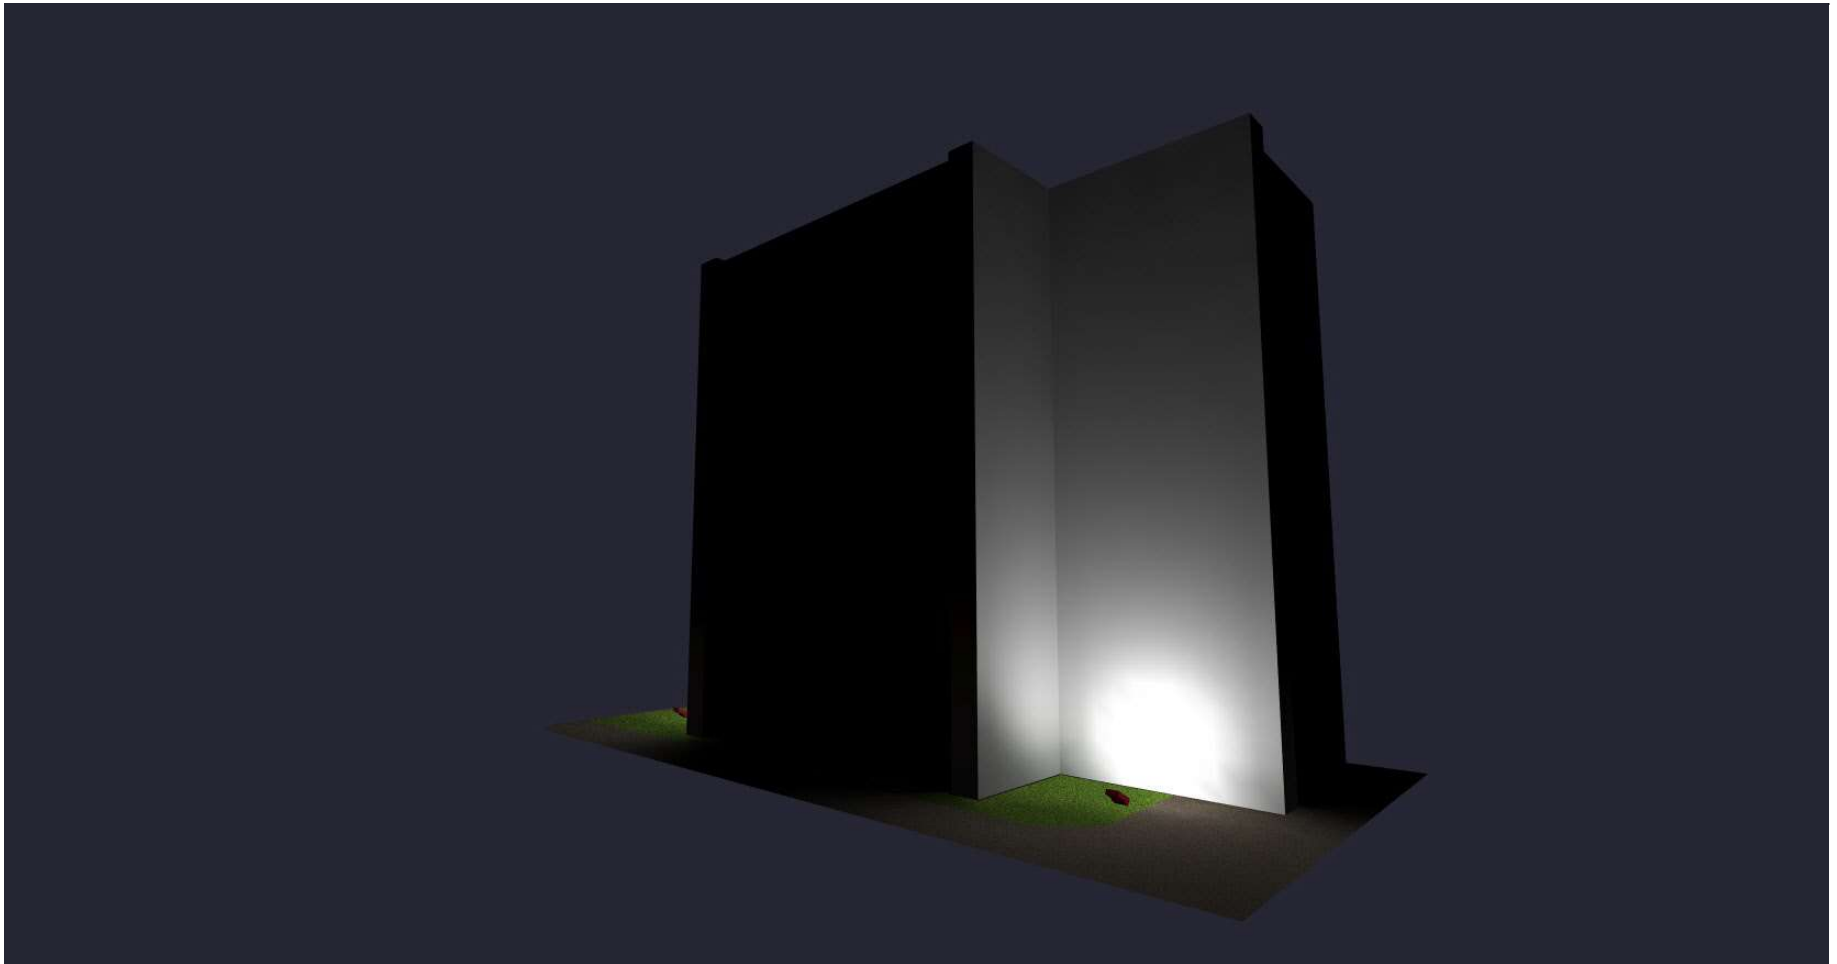

Carroll Uni Kilgour Hall
KT-FLED60-R1A
MH- .25' Tilt - 30°

Keystone Technologies Lighting Layout

2750 Morris Road
Lansdale, PA 19446
Phone 1-800-464-2680
Email: LightingLayouts@keystonetech.com



Thank you for allowing Keystone Technologies the opportunity to create and provide this Lighting Layout report.

Illumination results shown on this lighting design are based on project parametrics provided to Keystone used in conjunction with luminaire photometric testing conducted under laboratory conditions. Actual project conditions differing from these design parameters may affect field results, such as (but not limited to) windows, furnishings, floor/ceiling/wall surface texture reflectivity, site cleanliness, and lighting component tolerances. Illumination results shown have not been field verified by Keystone and therefore the actual measured results may vary from actual field conditions.

The customer is responsible for verifying dimensional accuracy along with compliance with any applicable electrical, lighting, or energy code. In no event will Keystone Technologies be held responsible for any loss resulting from any use of this lighting design.

Carroll Uni Kilgour Hall
KT-FLED60-R1A
MH- .25' Tilt - 30°

Keystone Technologies Lighting Layout

2750 Morris Road
Lansdale, PA 19446
Phone 1-800-464-2680
Email: LightingLayouts@keystonetech.com

