




- EXHIBIT WILL NOT BE RECORDED WITH EASEMENT
- SURVEY EXHIBIT WILL FOLLOW
- YELLOW HIGHTLIGHTED AREA= 15' WIDE EASEMENT

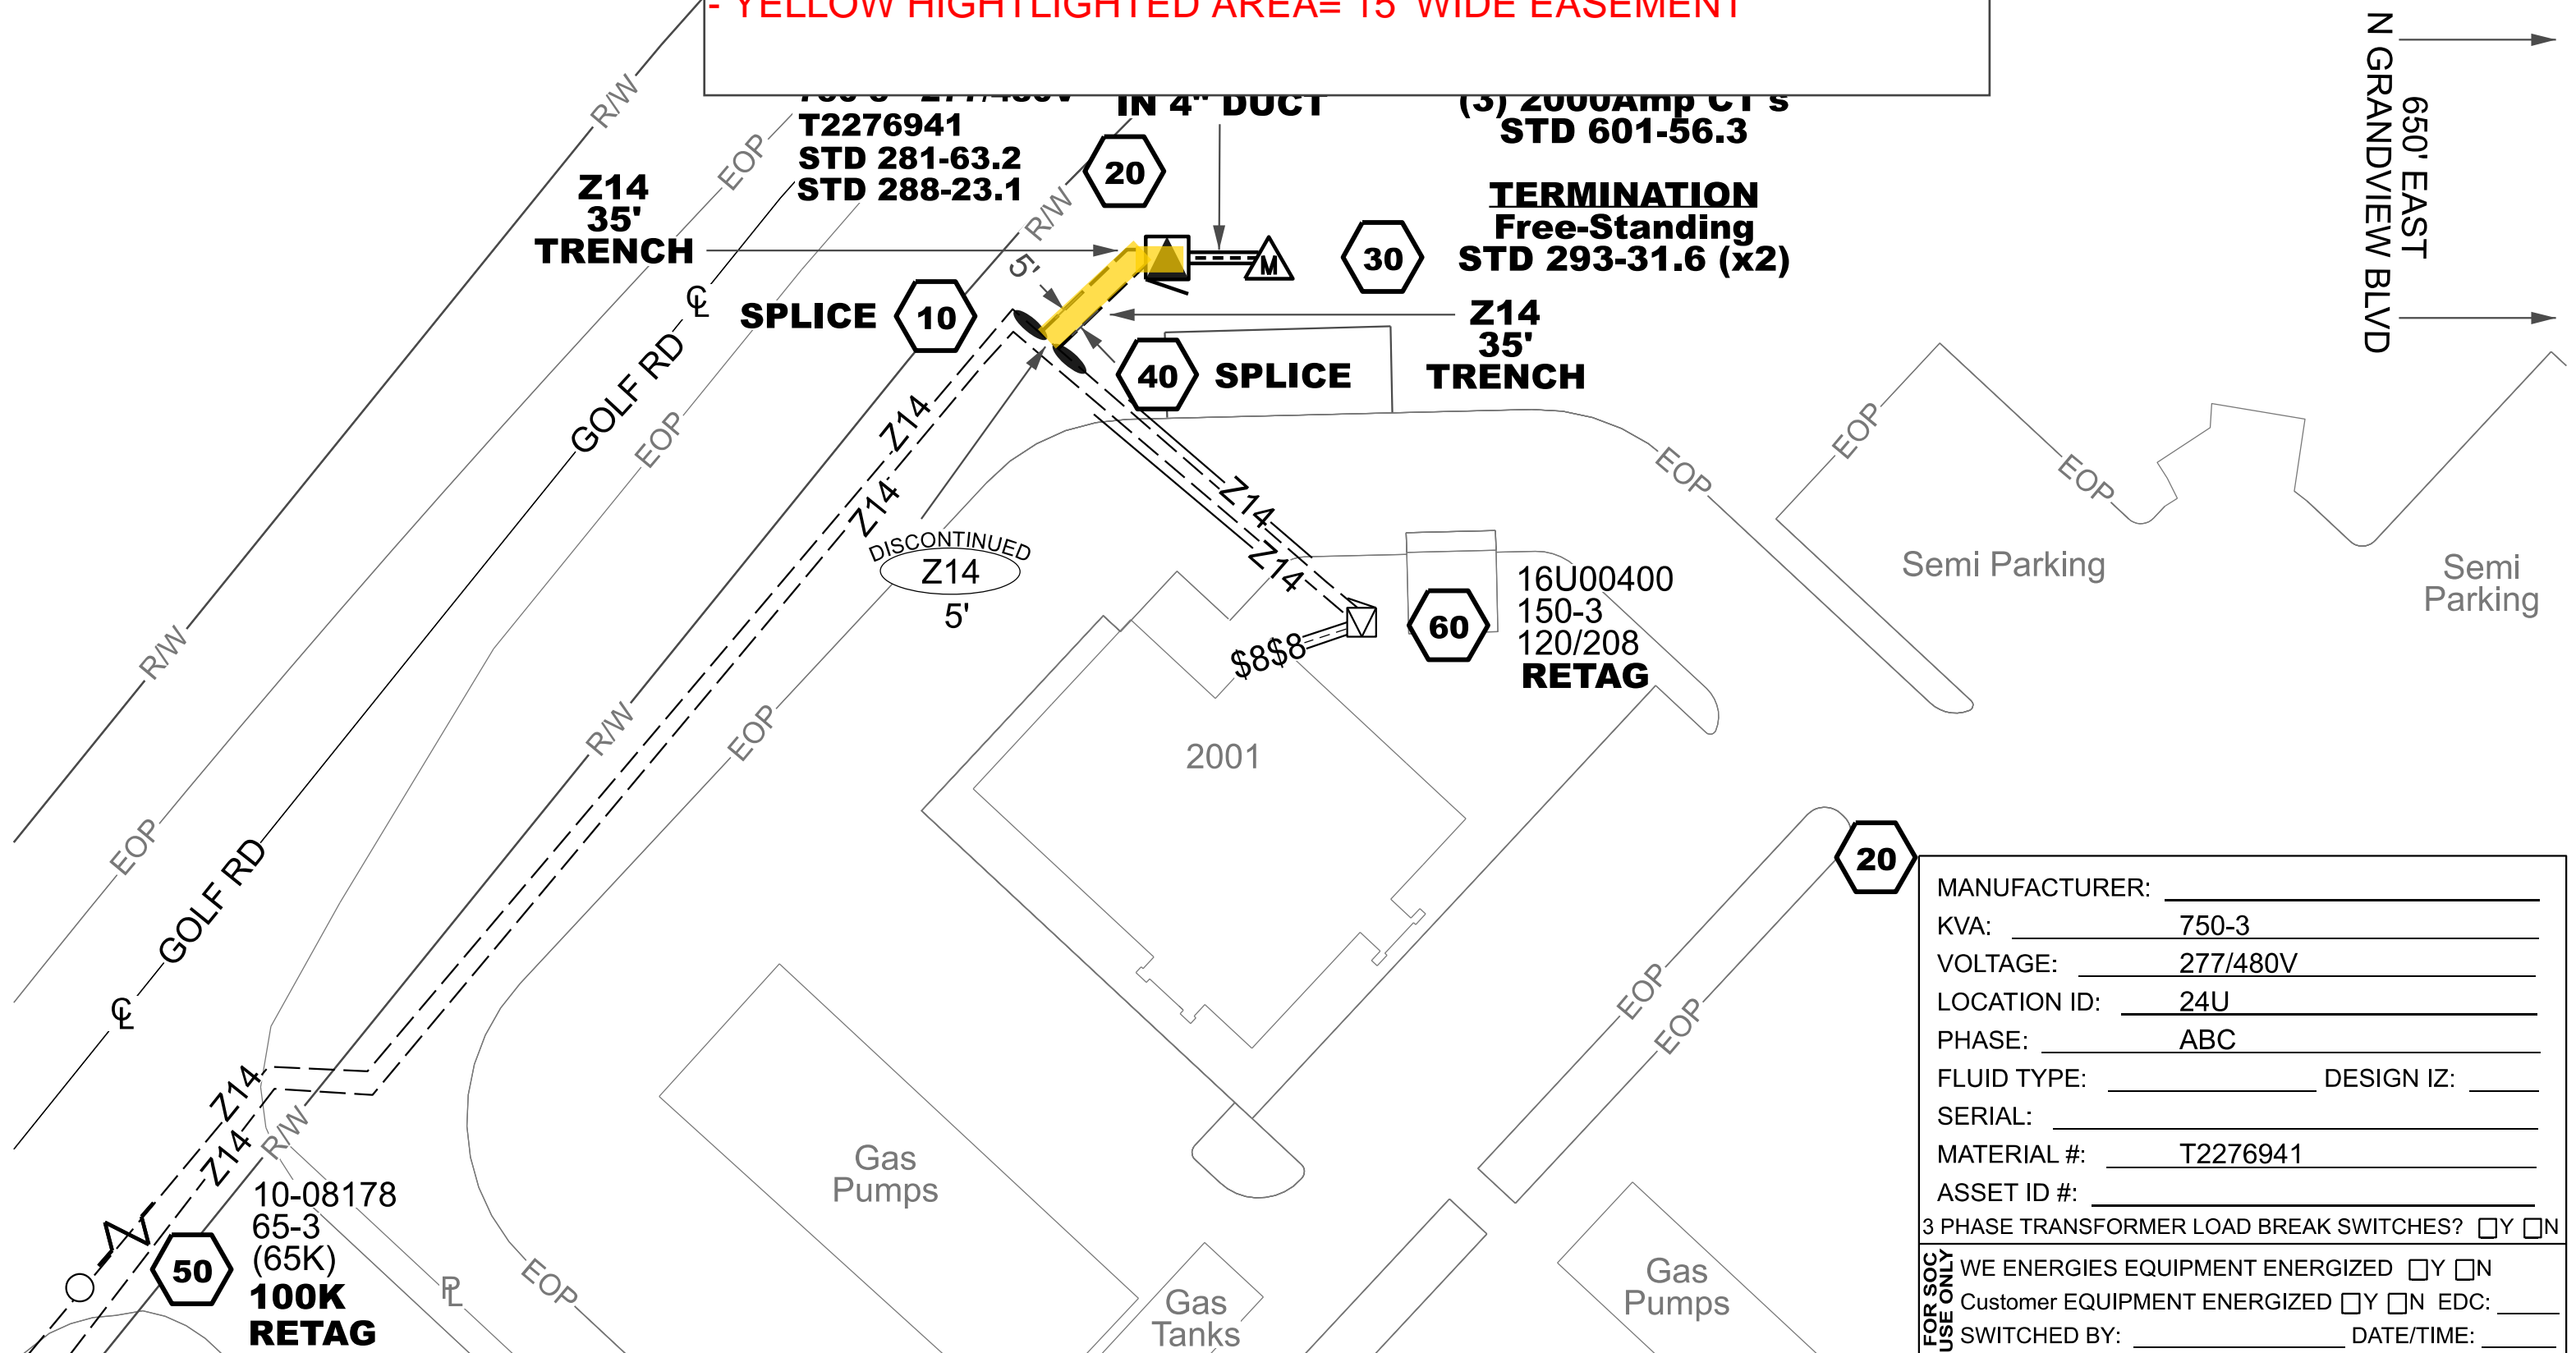

|  |   |                        |
|--|---|------------------------|
| FOR SOC<br>USE ONLY  | MANUFACTURER:   | _____                  |
|  | KVA:  | 750-3 _____            |
|  | VOLTAGE:  | 277/480V _____         |
|  | LOCATION ID:  | 24U _____              |
|  | PHASE:  | ABC _____              |
|  | FLUID TYPE:   | _____ DESIGN IZ: _____ |
|  | SERIAL:   | _____                  |
|  | MATERIAL #:   | T2276941 _____         |
| ASSET ID #:  | _____   |                        |
| 3 PHASE TRANSFORMER LOAD BREAK SWITCHES? <input type="checkbox"/> Y <input type="checkbox"/> N |   |                        |
| FOR SOC<br>USE ONLY  | WE ENERGIES EQUIPMENT ENERGIZED <input type="checkbox"/> Y <input type="checkbox"/> N         |                        |
|  | Customer EQUIPMENT ENERGIZED <input type="checkbox"/> Y <input type="checkbox"/> N EDC: _____ |                        |
|  | SWITCHED BY:  | _____ DATE/TIME: _____ |