


GENERAL NOTES:

- 1. DIMENSIONS SHOWN FOR EXTERIOR DOORS AND WINDOWS ARE ROUGH OPENINGS. UNLESS OTHERWISE
- 2. INTERIOR WALL DIMENSIONS ARE FROM FACE OF FINISH TO FACE OF FINISH
- UNLESS NOTED OTHERWISE. 3. UNLESS NOTED OTHERWISE, ALL INTERIOR DOORS SHALL BE INSTALLED WITH FACE OF FRAME 4" OFF FACE OF WALL.
- 4. PROVIDE CONTROL JOINTS EQUAL TO USG NO. 093 A MINIMUM OF 52 LINEAR FEET APART IN ALL DRYWALL PARTITIONS EXCEEDING 64 LINEAR FEET, AT ALL CORNERS OF ALL DOOR FRAMES, AND AT CORNERS OF GLAZING. DRYWALL SHALL BE INSTALLED PER THE LATEST EDITIONS OF "RECOMMENDED SPECIFICATIONS FOR THE APPLICATION AND FINISHING OF GYPSUM BOARD" GA-216 AS PUBLISHED BY THE GYPSUM ASSOCIATION AND THE "GYPSUM CONSTRUCTION HANDBOOK" AS PUBLISHED BY UNITED STATES GYPSUM COMPANY.
- 5. PROVIDE DOUBLE STUDS IN ALL DRYWALL PARTITIONS AT DOOR JAMB CONDITIONS. 6. ALL THROUGH WALL OPENINGS AND PENETRATIONS IN INDICATED FIRE RATED PARTITIONS SHALL BE PROPERLY FIRE SEALED IN ACCORDANCE WITH UL DESIGN AND THE LOCAL AUTHORITY HAVING JURISDICTION.
- 7. PAINT ALL EXTERIOR HM DOORS AND FRAMES (INCLUDING EXISTING). PROVIDE NEW ROD AND SEALANT ON ALL EXISTING
- DOOR FRAMES (PERIMETER) WHERE DEFECTIVE. 8. INSTALL NEW ROD AND SEALANT AT ALL EXTERIOR E.I.F.S., CMU, BRICK, AND/OR
- CONCRETE TILT WALL JOINTS THAT ARE DEFECTIVE OR MISSING.
- 9. FIELD VERIFY THE EXACT EXTENT OF ALL AREAS THAT REQUIRE INFILL SLABS, CEMENT UNDERLAYMENT AND/OR FLOOR SELFLEVELING COMPOUND. POUR NEW SLABS, INSTALL CEMENT UNDERLAYMENT AND SELF-LEVELING IN ALL AREAS WHERE REQUIRED.
- 10. REMOVE MOLD, MILDEW, RUST, STAINS AND OTHER CONTAMINANTS ON THE EXTERIOR SURFACES PRIOR TO ANY PAINTING OPERATIONS. CONFIRM METHODS AND OBTAIN APPROVAL FROM OWNER.
- 11. ALL EXTERIOR WINDOWS TO HAVE ALUMINUM FLASHING RETURNS AT HEAD, JAMBS, AND SILL OF ALL WINDOWS.
- 12. ALL EXTERIOR WINDOWS TO BE PREPPED FOR GYPSUM BOARD RETURNS AT HEAD AND JAMBS, INSTALLED DURING FUTURE BUILD-OUTS

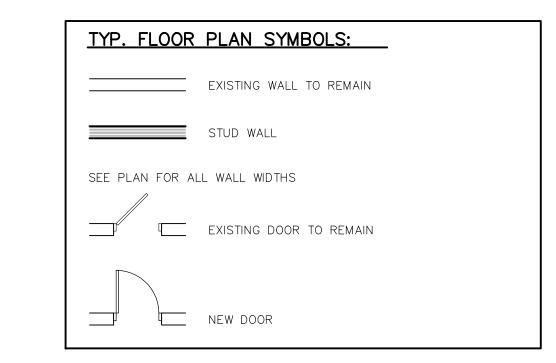

ARCHITECTURAL NOTES:

- $\overline{\langle A1 \rangle}$ existing opening to be infilled with New thermally broken storefront W/ 1" —/ INSULATED GLAZING
- NEW OPENING IN EXISTING WALL TO BE $\langle A2
 angle$ infilled with New Thermally Broken ─ STOREFRONT W/ 1" INSULATED GLAZING
- $\langle A3 \rangle$ new opening in New Wall infill area to Be infilled with New Thermally Broken
- ✓ STOREFRONT W/ 1" INSULATED GLAZING $\langle {\sf A4}
 angle$ new door in new wall infill area
- $\langle A5 \rangle$ NOT USED
- $\langle A6 \rangle$ NEW DOOR IN EXISTING DOOR OPENING
- A7 EXISTING WALL OPENING TO BE INFILLED. REFER TO SECTIONS AND DETAILS



100 CAMELOT DRIVE FOND DU LAC, WI 54935 PHONE: (920) 926-9800 FAX: (920) 926-9801

PROJE(

PRELIMINARY SHEET DATES:

JUNE 10, 2015 JUNE 16, 2015 JUNE 24, 2015

JULY 22. 2015

JOB NUMBER: 1403810

SHEET

PRELIMINARY DRAWING - NOT FOR CONSTRUCTION